WASCO Admin Issues - Bug #12098

Admin --> Login --> Wasco Form -->APPLICATION FOR SERVICE CONNECTION --> download Pdf --> date is coming static need to make date dynamic

12/23/2024 06:24 PM - Mohd Irfan

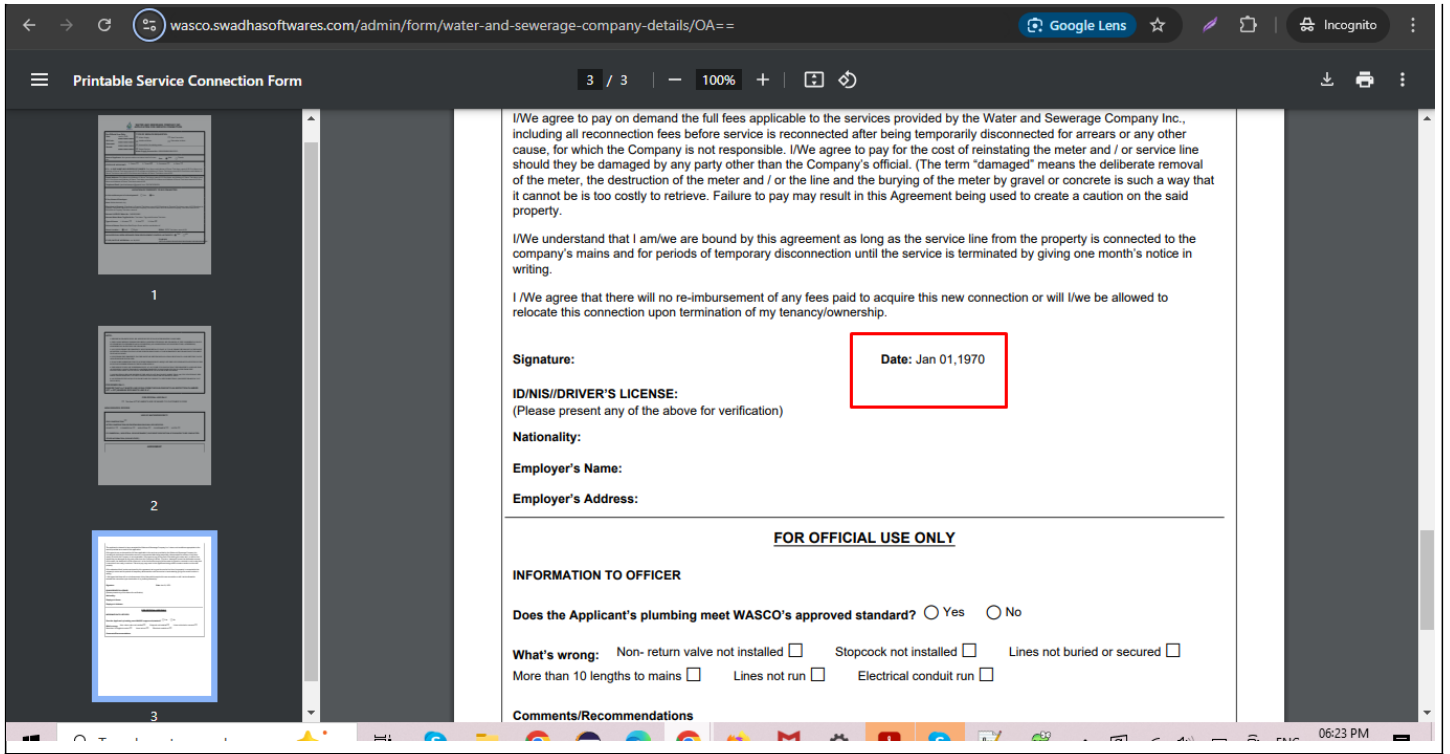|				
Status:	Resolved		**Start date:**	12/23/2024
Priority:	Normal		**Due date:**	
Assignee:	Abhimanyu jha		**% Done:**	0%
Category:			**Estimated time:**	0.00 hour
Target version:			**Spent time:**	0.00 hour

Description

Issue Description:

date is coming static need to make date dynamic

See attached screenshot/screen Record:

I/We agree to pay on demand the full fees applicable to the services provided by the Water and Sewerage Company Inc., including all reconnection fees before service is reconnected after being temporarily disconnected for arrears or any other cause, for which the Company is not responsible. I/We agree to pay for the cost of reinstating the meter and / or service line should they be damaged by any party other than the Company's official. (The term "damaged" means the deliberate removal of the meter, the destruction of the meter and / or the line and the burying of the meter by gravel or concrete is such a way that it cannot be is too costly to retrieve. Failure to pay may result in this Agreement being used to create a caution on the said property.

I/We understand that I am/we are bound by this agreement as long as the service line from the property is connected to the company's mains and for periods of temporary disconnection until the service is terminated by giving one month's notice in writing.

I /We agree that there will no re-imbursement of any fees paid to acquire this new connection or will I/we be allowed to relocate this connection upon termination of my tenancy/ownership.

Signature: Date: Jan 01,1970

ID/NIS//DRIVER'S LICENSE:
(Please present any of the above for verification)

Nationality:

Employer's Name:

Employer's Address:

FOR OFFICIAL USE ONLY

INFORMATION TO OFFICER

Does the Applicant's plumbing meet WASCO's approved standard? ○ Yes   ○ No

What's wrong: Non- return valve not installed ☐   Stopcock not installed ☐   Lines not buried or secured ☐

More than 10 lengths to mains ☐   Lines not run ☐   Electrical conduit run ☐

Comments/Recommendations

History

#1 - 12/26/2024 02:23 PM - Abhimanyu jha

- Status changed from New to Resolved

Files

clipboard-202412231823-xaepi.png	204 KB	12/23/2024	Mohd Irfan
clipboard-202412231823-wh6vw.png	161 KB	12/23/2024	Mohd Irfan